



# WATERLINE EXHIBIT MAP

## VILLAGE OF ASHVILLE

### PICKAWAY COUNTY, OHIO



Prepared By: Pomeroy & Associates Ltd. (614) 885-2498  
 Parcel Information Provided By: Pickaway County Auditor's office  
 Last Updated: 3/6/2017

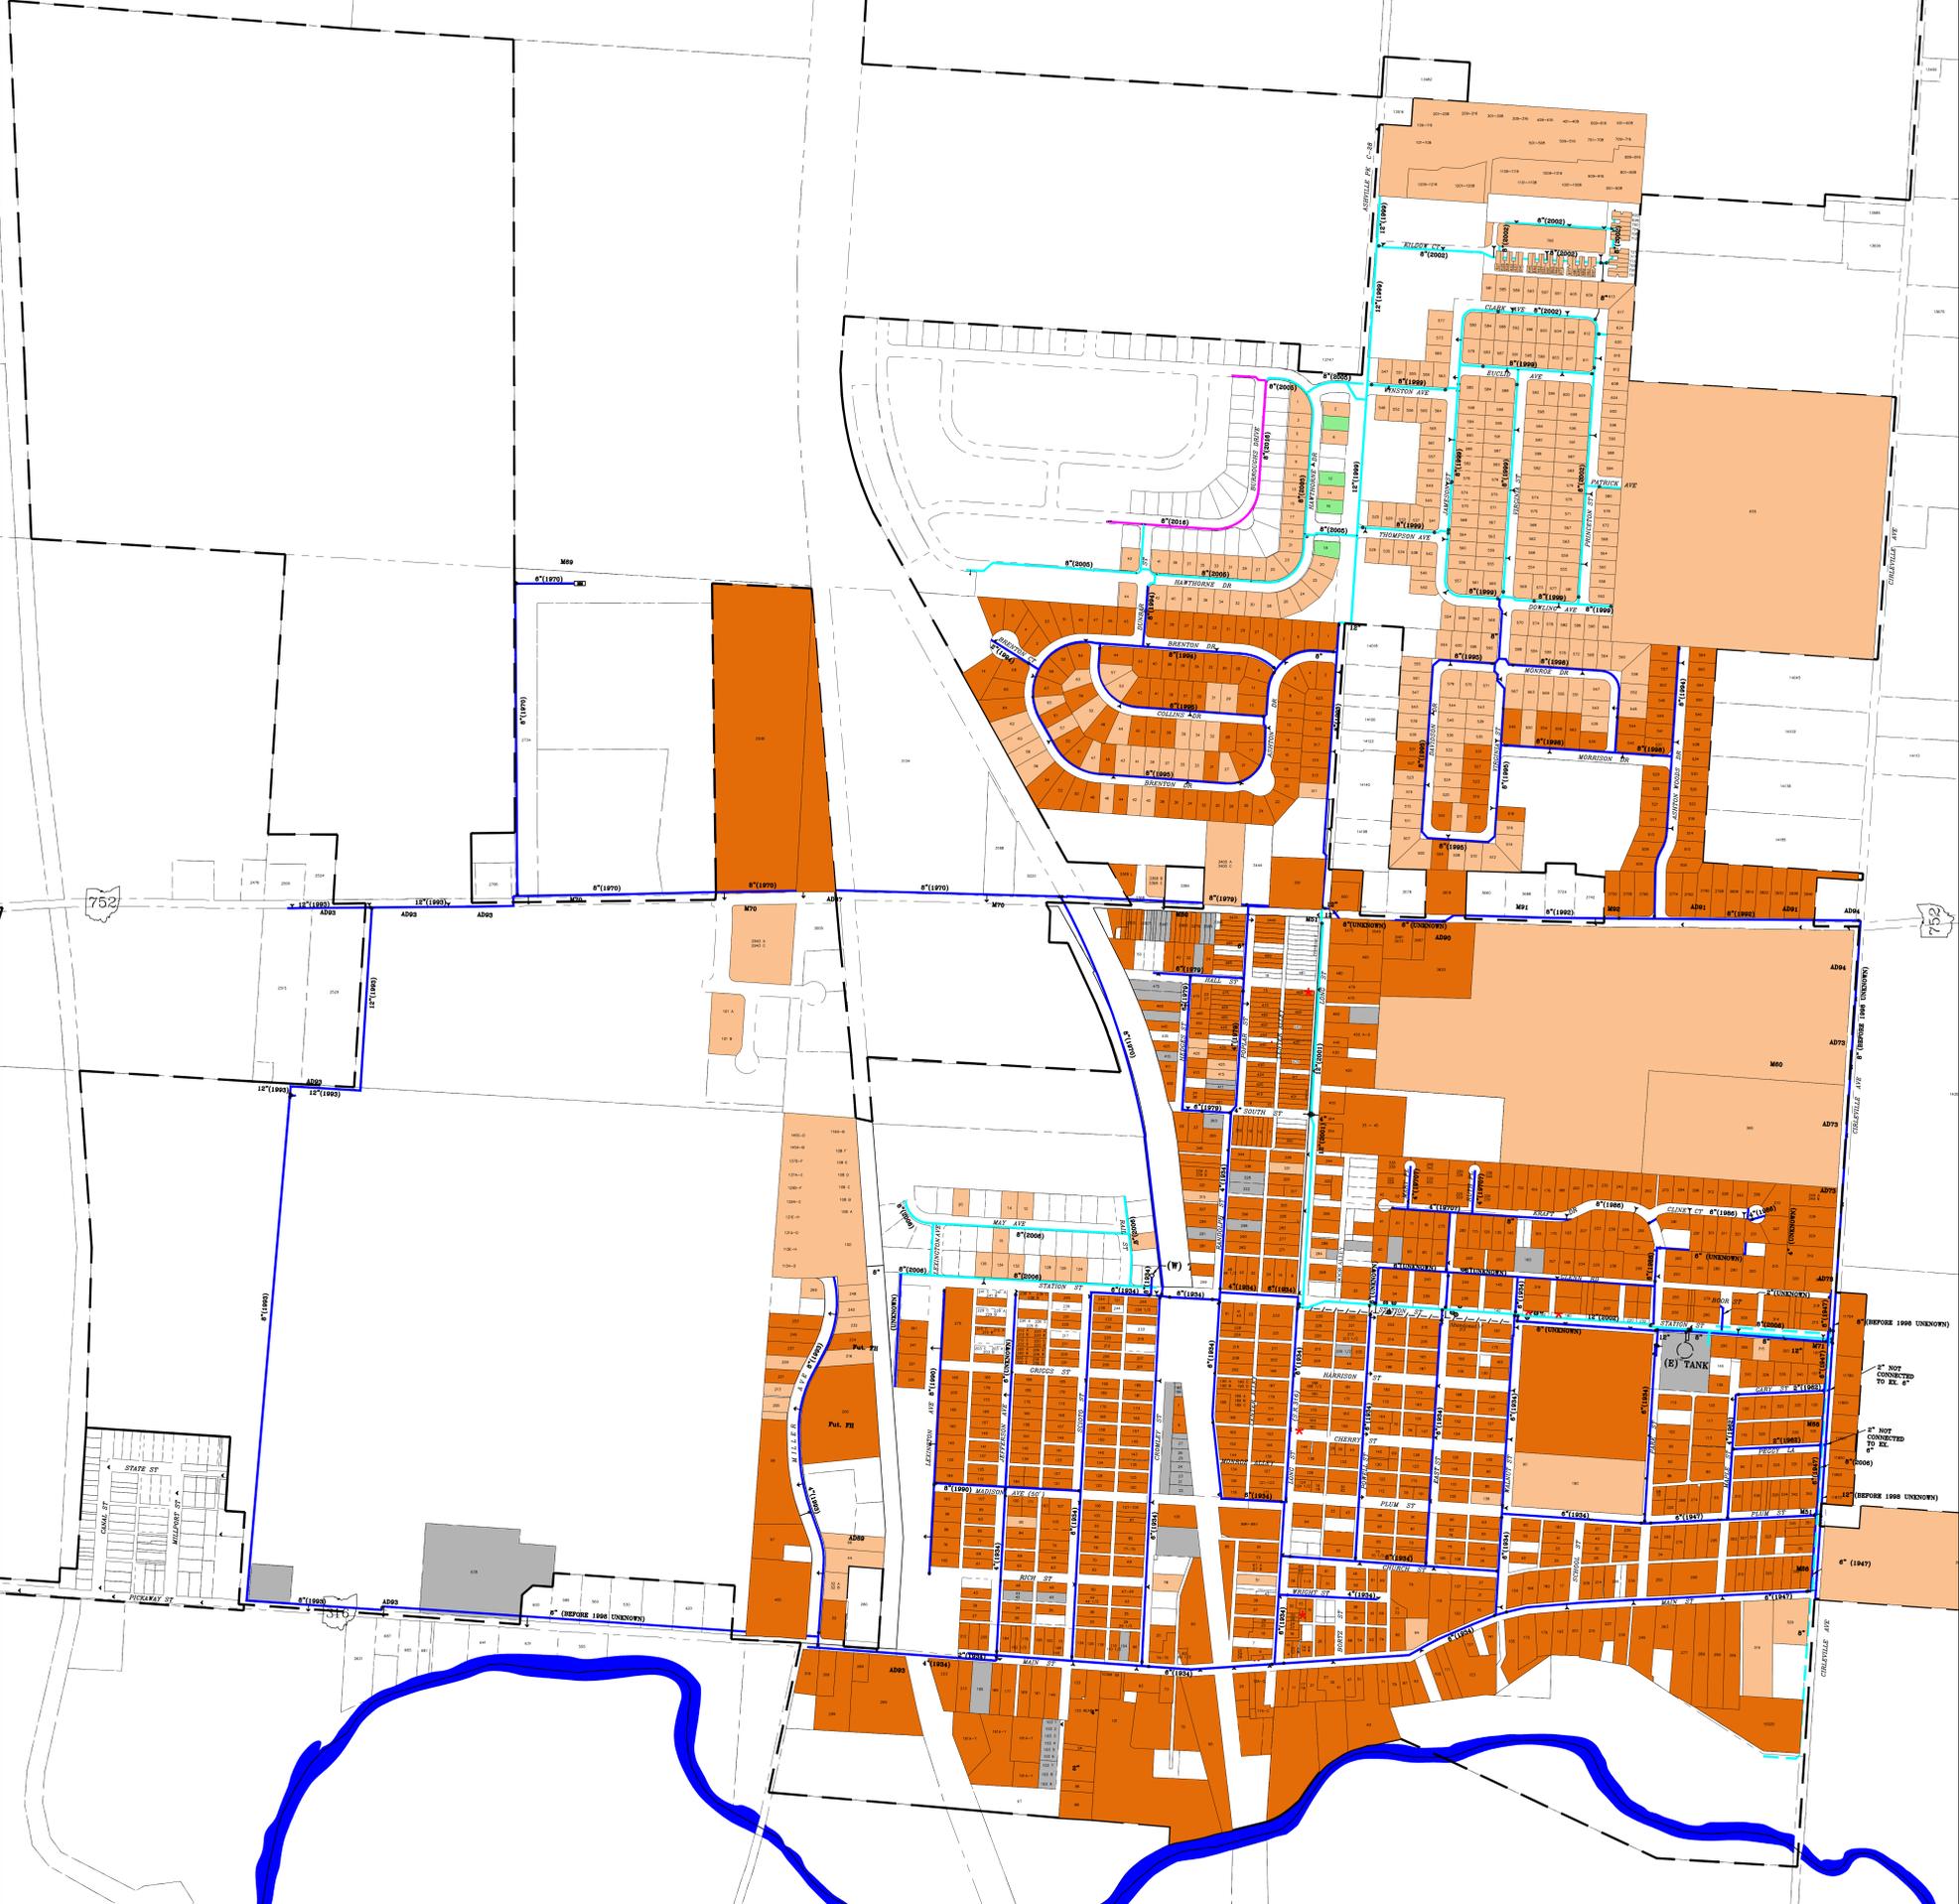

Date of Sample	Time Sample Taken	Laboratory Sample Number	Address of Sample Site	Tap Type and Location	Structure Type	Interior Plumbing Material	Service Line Material	Tier	Lead Conc (ug/L)	Copper Conc (ug/L)
7/30/2016	0700	0309206	255 KRAFT DRIVE	K	SFR	CuPb >82	Cu	1	<5.0	<5.0
7/21/2016	1000	0309200	465 LONG STREET	MR	BLDG	CuPb >82	Cu	2	<5.0	<5.0
7/21/2016	1020	0309201	501 LONG STREET	K	BLDG	CuPb >82	Cu	2	<5.0	<5.0
7/21/2016	1000	0309198	2943 ST RT 752	B	BLDG	OTHER	Cu	2	<5.0	<5.0
7/21/2016	1000	0309197	3625 ST RT 752	MR	BLDG	CuPb >82	Cu	2	<5.0	<5.0
7/21/2016	1100	0309203	21 HAWTHORNE DRIVE	K	SFR	OTHER	Cu	1	<5.0	<5.0
7/21/2016	0945	0309195	440 POPLAR STREET	K	SFR	CuPb >83	Cu	3	51	<5.0
7/8/2016	0600	0309190	189 W MAIN STREET	K	SFR	CuPb >83	Cu	3	<5.0	<5.0
7/9/2016	0700	0309185	291 CLINE COURT	K	SFR	CuPb >82	Cu	1	<5.0	<5.0
7/8/2016	0600	0309191	160 EAST STATION STREET	B	SFR	CuPb >83	Cu	3	<5.0	<5.0
7/30/2016	1000	0309205	26 EAST MAIN STREET	BS	BLDG	CuPb >83	Cu	2	50	7
7/30/2016	0945	0309204	3 EAST MAIN STREET	B	BLDG	CuPb >83	Cu	2	<5.0	9.4
7/8/2016	1200	0309193	17 ASHTON DRIVE	K	SFR	CuPb >82	Cu	1	<5.0	<5.0
7/21/2016	1015	0309199	320 LONG STREET	K	BLDG	CuPb >82	Cu	1	69	<5.0
7/8/2016	0800	0309187	4 CHERRY STREET	BR	BLDG	CuPb >83	Cu	2	70	<5.0
7/21/2016	1045	0309202	91 WEST MAIN STREET	B	BLDG	CuPb >83	Cu	2	72	<5.0
7/8/2016	0700	0309186	180 EAST STATION STREET	B	SFR	CuPb >83	Cu	3	83	<5.0
7/21/2016	0900	0309196	286 LONG STREET	B	BLDG	CuPb >82	OTHER	2	138	<5.0
7/8/2016	0800	0309189	34 LONG STREET	B	BLDG	CuPb >83	Cu	2	218	10.1
7/17/2016	0800	0309188	200 EAST STATION STREET	BR	BLDG	CuPb >83	Cu	2	233	<5.0

BASED ON THE REQUIREMENTS OF THE OHIO ENVIRONMENTAL PROTECTION AGENCY'S (EPA) GUIDELINES FOR LEAD MAPPING IN DISTRIBUTION SYSTEMS THIS MAP HAS BEEN PREPARED FROM HISTORICAL PERMIT PLANS. THE HISTORICAL PERMIT PLANS WERE REVIEWED FOR INFORMATION REGARDING DATE OF INSTALLATION AND MATERIALS OF THE EXISTING PUBLIC WATER SYSTEM. FOR PORTIONS OF THE EXISTING PUBLIC WATER SYSTEM THAT DO NOT HAVE HISTORICAL PERMIT PLANS AVAILABLE, THE INSTALLATION OF THE PORTION OF THE EXISTING PUBLIC WATER SYSTEM FEEDING THAT PORTION OF THE SYSTEM WERE EVALUATED TO ESTABLISH AN ESTIMATED DATE OF INSTALLATION. ONCE THE DATES OF INSTALLATION WERE ESTABLISHED, THE WATERLINES WERE DIVIDED INTO THREE CATEGORIES:

INSTALLED PRIOR TO 1998 (HIGHER POTENTIAL LEAD RISK)  
 INSTALLED FROM 1998 TO 2014 (POTENTIAL LEAD RISK)  
 INSTALLED FROM 2014 TO PRESENT (LOWER LEAD RISK)

THE MAINTENANCE AND OPERATION RECORDS, WHICH CONSISTS OF TAP LOGS, AND REPAIR AND MAINTENANCE RECORDS, WERE REVIEWED. IT HAS BEEN DETERMINED THAT THE EXISTING PUBLIC WATER SYSTEM CONSISTS OF GALVANIZED STEEL, CAST IRON, DUCTILE IRON, AND COPPER SERVICE LINES. BASED ON THIS REVIEW, THE EXISTING PUBLIC WATER SYSTEM DOES NOT CONTAIN ANY PUBLIC LEAD SERVICE LINES.

THE BUILDING PERMIT PLANS WERE REVIEWED FOR INFORMATION REGARDING THE MATERIALS OF THE EXISTING BUILDING DISTRIBUTION SYSTEMS. THE VILLAGE OF ASHVILLE SHARES REVIEW AND APPROVAL OF BUILDING PERMITS WITH THE CITY OF CINCINNATI AND PICKAWAY COUNTY. AS SUCH, THE VILLAGE DOES NOT HAVE POSSESSION OF ALL BUILDING PLANS FOR THE VILLAGE OF ASHVILLE. THE PLUMBING PLANS THAT HAVE BEEN REVIEWED/APPROVED BY THE VILLAGE HAVE BEEN PROVIDED TO THE EPA AND ARE AVAILABLE UPON REQUEST FROM THE VILLAGE OF ASHVILLE.

THE PROPERTY OWNERS SHOULD CHECK PRIVATE SERVICE LINE MATERIAL FOR LEAD. BUILDINGS IN OHIO BUILT PRIOR TO 1998 OR THAT USE PLUMBING MATERIAL OR SOLDER MANUFACTURED BEFORE 1998 MAY HAVE MATERIALS WITH GREATER THAN 8% LEAD AND ARE AT A HIGHER RISK OF CONTRIBUTING LEAD TO THE DRINKING WATER THAN MATERIALS MANUFACTURED AFTER 1998. IN ADDITION, BUILDINGS BUILT AND PLUMBING MATERIALS MANUFACTURED AFTER 2014 WERE REQUIRED TO HAVE LESS THAN 0.05% LEAD BY WEIGHT AND HAVE THE LOWEST RISK FOR CONTRIBUTING LEAD TO THE DRINKING WATER. IT SHOULD BE NOTED HOWEVER THAT, ALTHOUGH PROHIBITED, SOME USE OF LEADED SOLDER OR LEADED COMPONENTS MAY HAVE OCCURRED AFTER THE PROHIBITIONS BECAME EFFECTIVE. FOR MORE DETAILS CONTACT THE VILLAGE OF ASHVILLE.

**LEGEND**

**LINE TYPES**

- Water Lines Constructed: Prior to 1998 (Blue line)
- Water Lines Constructed: 1998-2014 (Orange line)
- Water Lines Constructed: 2014-CURRENT (Yellow line)
- Services Constructed: Prior to 1998 (Blue line)
- Services Constructed: 1998-2014 (Orange line)
- Services Constructed: 2014-CURRENT (Yellow line)
- Current LOR Sampling Locations (Red star)
- Parcels (Thin black outline)
- Limits of Village (Thick black outline)
- Parcel Numbers (Small numbers on map)
- Hydrants (Circle with cross)
- Valves (Circle with 'V')
- Year Installed (Number in circle)

# WATERLINE EXHIBIT MAP

## VILLAGE OF ASHVILLE, OHIO